


Company _____ Location _____ Date _____

Vol 27 - No 39 FALLING WALL ACCIDENT

INCIDENT DESCRIPTION:

A 27 year old worker with 1 year of job experience was in the process of locating an underground water line. A trench had been dug approximately 4 feet deep along side of a brick wall 7 feet high and 15 feet long. The brick wall collapsed onto the victim who was working in the trench at the time. His injuries were fatal.



SAFETY RECOMMENDATION:


Employers or contractors should never allow employees to excavate below the level of the base of a foundation when walls are unpinned.

Company _____ Location _____ Date _____

Vol 27 - No 39 FALLING WALL ACCIDENT

INCIDENT DESCRIPTION:

A 27 year old worker with 1 year of job experience was in the process of locating an underground water line. A trench had been dug approximately 4 feet deep along side of a brick wall 7 feet high and 15 feet long. The brick wall collapsed onto the victim who was working in the trench at the time. His injuries were fatal.

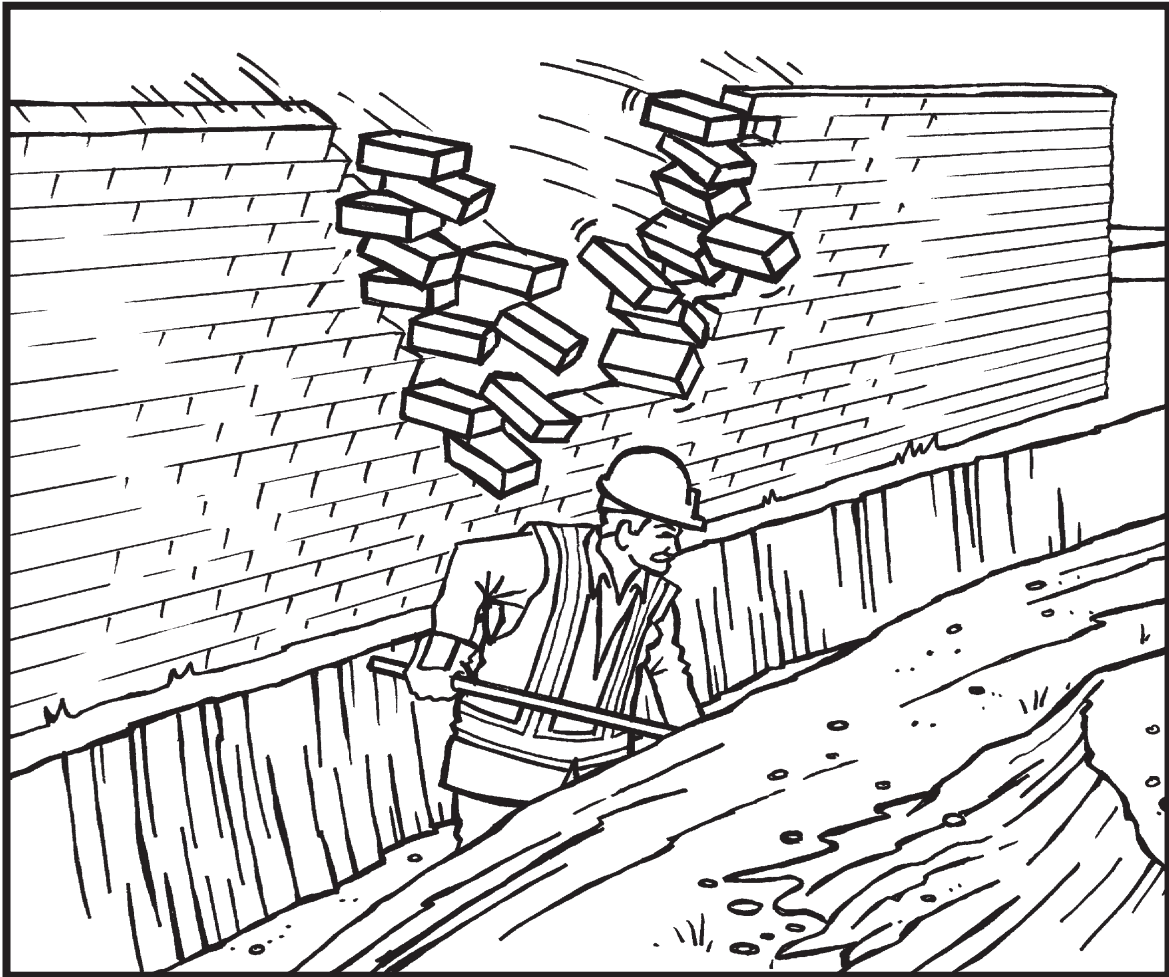

SAFETY RECOMMENDATION:

Employers or contractors should never allow employees to excavate below the level of the base of a foundation when walls are unpinning.